Test Report issued under the responsibility of:

TEST REPORT
IEC 62619
Secondary cells and batteries containing alkaline or other non-acid electrolytes – Safety requirements for secondary lithium cells and batteries, for use in industrial applications

Report Number.....:	CNDQ-ESH-P25010180
Date of issue.....:	2025-03-03
Total number of pages.....:	30 Pages
Name of Testing Laboratory preparing the Report.....:	LCIE CHINA COMPANY LIMITED Building 4, No. 518, Xin Zhuan Road, CaoHejing Songjiang High-Tech Park, Shanghai P.R.C (201612)
Applicant's name .....:	SRNE Solar Co., Ltd
Address .....:	4-5F, Building13A, Taihua Wutong Industrial Park, Gushu Development Zone, Hangcheng Street, Baoan, Shenzhen 518126 Guangdong, P.R. China
Test specification:	
Standard .....:	IEC 62619:2022
Test procedure .....:	CB Scheme
Non-standard test method .....:	N/A
TRF template used .....:	IECEE OD-2020-F1:2022, Ed.1.5
Test Report Form No.....:	IEC62619B
Test Report Form(s) Originator ....:	UL Solutions (Demko)
Master TRF .....:	Dated 2023-02-24

Copyright © 2023 IEC System of Conformity Assessment Schemes for Electrotechnical Equipment and Components (IECEE System). All rights reserved.

This publication may be reproduced in whole or in part for non-commercial purposes as long as the IECEE is acknowledged as copyright owner and source of the material. IECEE takes no responsibility for and will not assume liability for damages resulting from the reader's interpretation of the reproduced material due to its placement and context.

If this Test Report Form is used by non-IECEE members, the IECEE/IEC logo and the reference to the CB Scheme procedure shall be removed.

This report is not valid as a CB Test Report unless signed by an approved IECEE Testing Laboratory and appended to a CB Test Certificate issued by an NCB in accordance with IECEE 02.

General disclaimer:

The test results presented in this report relate only to the object tested.
This report shall not be reproduced, except in full, without the written approval of the Issuing NCB. The authenticity of this Test Report and its contents can be verified by contacting the NCB, responsible for this Test Report.

Test item description..... :	Lithium Battery Energy Storage
Trademark(s)..... :	SRNE
Manufacturer..... :	SRNE SOLAR CO., LTD Dongguan Branch Room 301, Building 5th, Fuxing Rd No.36, Chang'an Town, Dongguan City, Guangdong, P.R. China
Model/Type reference..... :	SR-SE05B, SR-EOC05B-UL, SR-EOS05B-Pro
Ratings..... :	51,2V, 100Ah, 5,12kWh

Responsible Testing Laboratory (as applicable), testing procedure and testing location(s):

☒	**CB Testing Laboratory:**	LCIE CHINA COMPANY LIMITED	
Testing location/ address.....:		Building 4, No. 518, Xin Zhuan Road, CaoHejing Songjiang High-Tech Park, Shanghai P.R.C (201612)	
Tested by (name, function, signature).....:		Alter Qiu (Project Manager)	Alter Qiu
Approved by (name, function, signature)...:		Amy Dong (Project Manager)	Amy Dong
☐	**Testing procedure: CTF Stage 1:**		
Testing location/ address.....:			
Tested by (name, function, signature).....:			
Approved by (name, function, signature)...:			
☐	**Testing procedure: CTF Stage 2:**		
Testing location/ address.....:			
Tested by (name + signature) .....:			
Witnessed by (name, function, signature)..:			
Approved by (name, function, signature)...:			
☐	**Testing procedure: CTF Stage 3:**		
☐	**Testing procedure: CTF Stage 4:**		
Testing location/ address.....:			
Tested by (name, function, signature).....:			
Witnessed by (name, function, signature)..:			
Approved by (name, function, signature)...:			
Supervised by (name, function, signature) :			

List of Attachments (including a total number of pages in each attachment):

Attachment 1 (Pictures for product): Page 25 to Page 30

Summary of testing:

Tests performed (name of test, test clause and date test performed):	**Testing location: (CBTL, SPTL, CTF, Subcontractor)**
- 5.9 Quality plan - 7.2.3 Drop test (battery system) 7.2.3.3 Edge and corner drop test (battery system) - 8.2.2 Overcharge control of voltage (battery system) - 8.2.3 Overcharge control of current (battery system) - 8.2.4 Overheating control (battery system)	LCIE CHINA COMPANY LIMITED Building 4, No. 518, Xin Zhuan Road, CaoHejing Songjiang High-Tech Park, Shanghai P.R.C (201612)

Summary of compliance with National Differences (List of countries addressed):

N/A

☒ **The product fulfils the requirements of EN IEC 62619:2022.**

Use of uncertainty of measurement for decisions on conformity (decision rule) :

☒ No decision rule is specified by the IEC standard, when comparing the measurement result with the applicable limit according to the specification in that standard. The decisions on conformity are made without applying the measurement uncertainty ("simple acceptance" decision rule, previously known as "accuracy method").

☐ Other: … (to be specified, for example when required by the standard or client, or if national accreditation requirements apply)

Information on uncertainty of measurement:


The uncertainties of measurement are calculated by the laboratory based on application of criteria given by OD-5014 for test equipment and application of test methods, decision sheets and operational procedures of IECEE.

IEC Guide 115 provides guidance on the application of measurement uncertainty principles and applying the decision rule when reporting test results within IECEE scheme, noting that the reporting of the measurement uncertainty for measurements is not necessary unless required by the test standard or customer.

Calculations leading to the reported values are on file with the NCB and testing laboratory that conducted the testing.

Copy of marking plate:

The artwork below may be only a draft. The use of certification marks on a product must be authorized by the respective NCBs that own these marks.

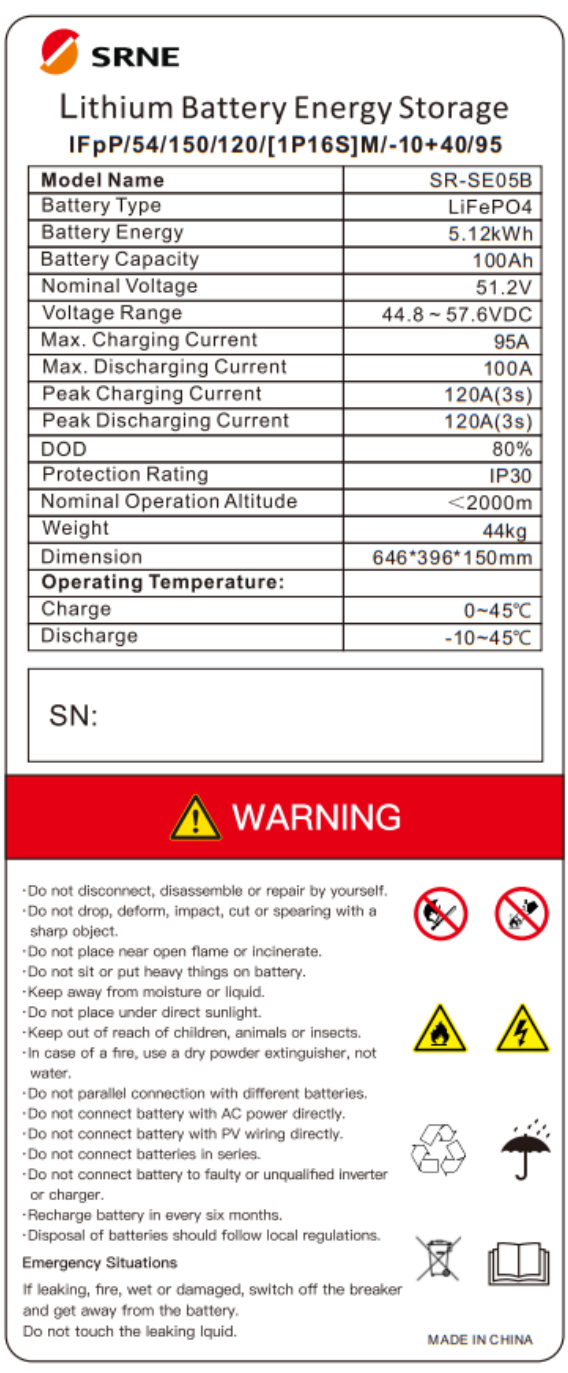

SRNE

Lithium Battery Energy Storage

IFpP/54/150/120/[1P16S]M/-10+40/95

Model Name	SR-SE05B
Battery Type	LiFePO4
Battery Energy	5.12kWh
Battery Capacity	100Ah
Nominal Voltage	51.2V
Voltage Range	44.8 ~ 57.6VDC
Max. Charging Current	95A
Max. Discharging Current	100A
Peak Charging Current	120A(3s)
Peak Discharging Current	120A(3s)
DOD	80%
Protection Rating	IP30
Nominal Operation Altitude	<2000m
Weight	44kg
Dimension	646*396*150mm
Operating Temperature:	
Charge	0~45℃
Discharge	-10~45℃

SN:


WARNING

·Do not disconnect, disassemble or repair by yourself.
·Do not drop, deform, impact, cut or spearing with a sharp object.
·Do not place near open flame or incinerate.
·Do not sit or put heavy things on battery.
·Keep away from moisture or liquid.
·Do not place under direct sunlight.
·Keep out of reach of children, animals or insects.
·In case of a fire, use a dry powder extinguisher, not water.
·Do not parallel connection with different batteries.
·Do not connect battery with AC power directly.
·Do not connect battery with PV wiring directly.
·Do not connect batteries in series.
·Do not connect battery to faulty or unqualified inverter or charger.
·Recharge battery in every six months.
·Disposal of batteries should follow local regulations.

Emergency Situations

If leaking, fire, wet or damaged, switch off the breaker and get away from the battery.
Do not touch the leaking liquid.

MADE IN CHINA

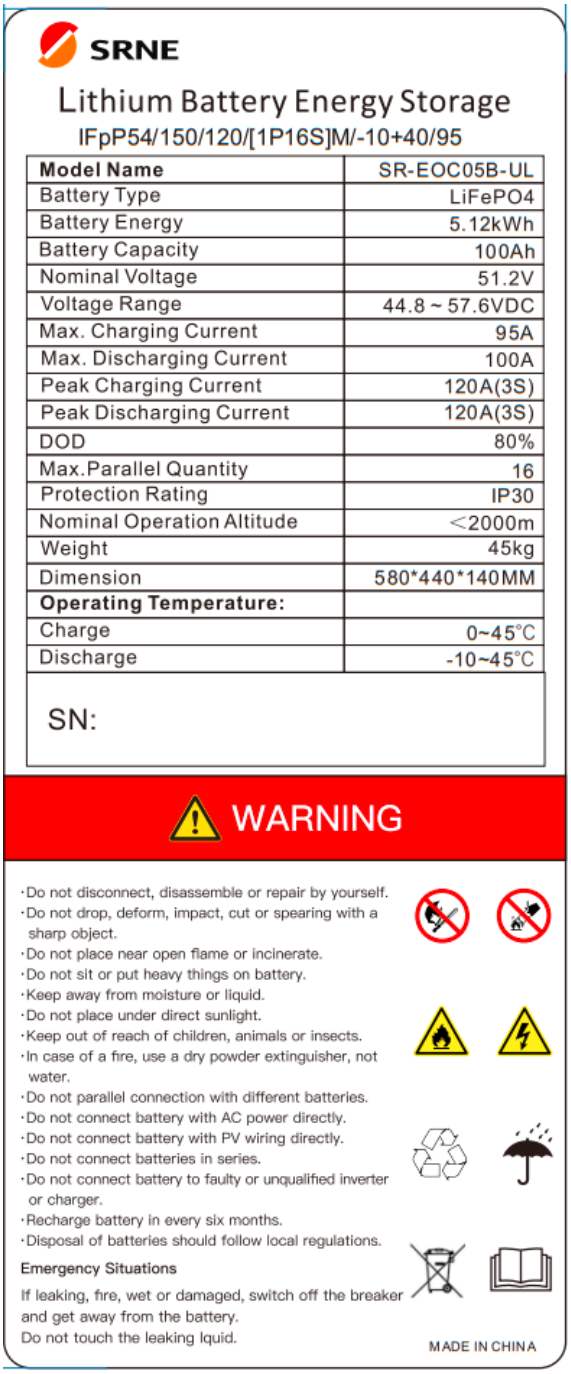

SRNE

Lithium Battery Energy Storage

IFpP54/150/120/[1P16S]M/-10+40/95

Model Name	SR-EOC05B-UL
Battery Type	LiFePO4
Battery Energy	5.12kWh
Battery Capacity	100Ah
Nominal Voltage	51.2V
Voltage Range	44.8 ~ 57.6VDC
Max. Charging Current	95A
Max. Discharging Current	100A
Peak Charging Current	120A(3S)
Peak Discharging Current	120A(3S)
DOD	80%
Max.Parallel Quantity	16
Protection Rating	IP30
Nominal Operation Altitude	<2000m
Weight	45kg
Dimension	580*440*140MM
Operating Temperature:	
Charge	0~45°C
Discharge	-10~45°C

SN:

WARNING

·Do not disconnect, disassemble or repair by yourself.
·Do not drop, deform, impact, cut or spearing with a sharp object.
·Do not place near open flame or incinerate.
·Do not sit or put heavy things on battery.
·Keep away from moisture or liquid.
·Do not place under direct sunlight.
·Keep out of reach of children, animals or insects.
·In case of a fire, use a dry powder extinguisher, not water.
·Do not parallel connection with different batteries.
·Do not connect battery with AC power directly.
·Do not connect battery with PV wiring directly.
·Do not connect batteries in series.
·Do not connect battery to faulty or unqualified inverter or charger.
·Recharge battery in every six months.
·Disposal of batteries should follow local regulations.

Emergency Situations

If leaking, fire, wet or damaged, switch off the breaker and get away from the battery.
Do not touch the leaking liquid.

MADE IN CHINA

SRNE

Lithium Battery Energy Storage

IFpP/54/150/120/[1P16S]M/-10+40/95

Model Name	SR-EOS05B-Pro
Battery Type	LiFePO4
Battery Energy	5.12kWh
Battery Capacity	100Ah
Nominal Voltage	51.2V
Voltage Range	44.8 ~ 57.6VDC
Max. Charging Current	95A
Max. Discharging Current	100A
Peak Charging Current	120A(3s)
Peak Discharging Current	120A(3s)
DOD	80%
Protection Rating	IP65
Nominal Operation Altitude	<2000m
Weight	49kg
Dimension	760*405*151MM
Operating Temperature:	
Charge	0~45℃
Discharge	-10~45℃

SN:

WARNING


-Do not disconnect, disassemble or repair by yourself.
-Do not drop, deform, impact, cut or spearing with a sharp object.
-Do not place near open flame or incinerate.
-Do not sit or put heavy things on battery.
-Keep away from moisture or liquid.
-Do not place under direct sunlight.
-Keep out of reach of children, animals or insects.
-In case of a fire, use a dry powder extinguisher, not water.
-Do not parallel connection with different batteries.
-Do not connect battery with AC power directly.
-Do not connect battery with PV wiring directly.
-Do not connect batteries in series.
-Do not connect battery to faulty or unqualified inverter or charger.
-Recharge battery in every six months.
-Disposal of batteries should follow local regulations.

Emergency Situations

If leaking, fire, wet or damaged, switch off the breaker and get away from the battery.
Do not touch the leaking liquid.

MADE IN CHINA

Polarity:

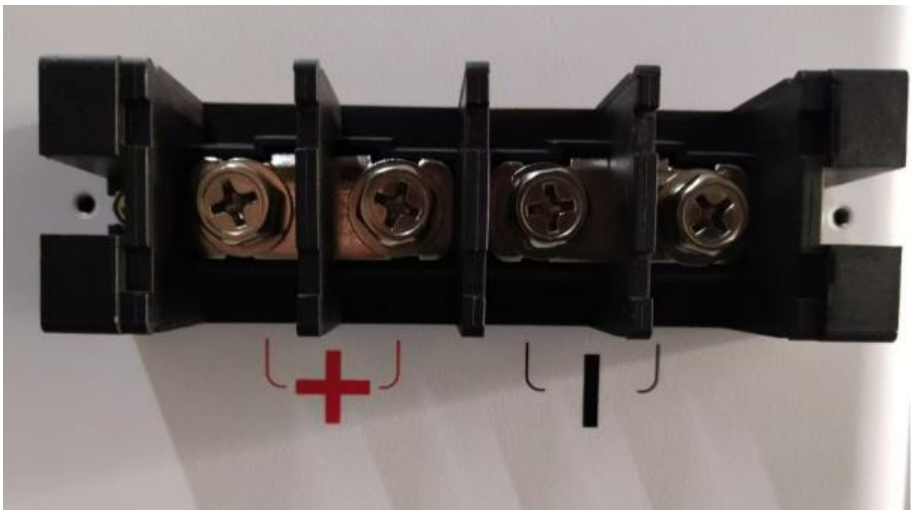

Remark:



The manufacture date is in the 3th to 8th digits of the bar code (SR-241112LC001-301801-S000110), the bar code rule shows below:

1. The 3th-4th digits represent the year, eg “24” is 2024 year;
2. The 5th-6th digits represent the month, eg “11” is November;
3. The 7th-8th digits represent the day, eg ”12” is 12 day.

Test item particulars .....:	
Classification of installation and use.....:	To be defined in final product
Supply Connection .....:	Terminals
.....:	
Possible test case verdicts:	
- test case does not apply to the test object..... :	N/A
- test object does meet the requirement..... :	P (Pass)
- test object does not meet the requirement..... :	F (Fail)
Testing ..... :	
Date of receipt of test item..... :	2025-01-03
Date (s) of performance of tests ..... :	2025-01-03 to 2025-01-17

General remarks:

"(See Enclosure #)" refers to additional information appended to the report.
"(See appended table)" refers to a table appended to the report.

Throughout this report a ☒ comma / ☐ point is used as the decimal separator.

☐ **This Test Report Form contains requirements according to IEC/ISO …... Standard dated ….. and includes** Corrigendum dated …….
(Note: The above text maybe removed if not applicable)

Manufacturer's Declaration per sub-clause 4.2.5 of IECEE 02:

The application for obtaining a CB Test Certificate includes more than one factory location and a declaration from the Manufacturer stating that the sample(s) submitted for evaluation is (are) representative of the products from each factory has been provided.....:	☐ **Yes** ☒ **Not applicable**

When differences exist; they shall be identified in the General product information section.

Name and address of factory (ies)..... :	Same as Manufacturer

General product information and other remarks:

The SR-SE05B is a Li-on battery with a nominal voltage of 51,2V and a Rated capacity of 100Ah which is used in energy storage applications.

The battery system consists of 16 Lithium Iron Phosphate cells connected in 16S1P; cell model no. is CB79.

SR-SE05B, SR-EOC05B-UL and SR-EOS05B-Pro only the model names and enclosure are different, everything else is the same. The tested model SR-SE05B is representative of all models. SR-EOC05B-UL and SR-EOS05B-Pro only proceed 7.2.3 Drop test.

The main features of the battery are shown as below:

Cell and battery	Cell	Battery System
Model Name	CB79	SR-SE05B
Rated capacity (Ah)	100	100
Nominal voltage (V)	3,2	51,2
Standard Charge Current (A)	50	50
Standard Discharge Current (A)	50	50
Maximum continuous charge current (A)	100	95
Maximum continuous discharge current (A)	150	100
Charge temperature Range (°C)	-10~60	0~45
Discharge temperature Range (°C)	-20~60	-10~45
Standard Charge Voltage (V)	3,65	57,6
Upper limit Charging Voltage (V)	3,75	57,6
End-of-discharge Voltage (V)	2,5	44.8
Weight (kg)	1,87±0,15	44
Recommend charging method declared by the manufacturer	Charging the cell with 50A constant current until to 3,65V, then constant voltage 3,65V until charging current reduces to 5A	Charge the battery at constant current 50A until voltage reaches 57,6V, then charge at constant voltage 57,6V till charge current is 5A

IEC 62619			
Clause	Requirement + Test	Result - Remark	Verdict
4	**PARAMETER MEASUREMENT TOLERANCES**		P
	Parameter measurement tolerances		P

5	**GENERAL SAFETY CONSIDERATIONS**		P
5.1	**General**		**P**
	Cells and batteries are safe under conditions of both intended use and reasonably foreseeable misuse… :	See also table 5.1 for Critical components information	P
	Reduce the risk of injuries from moving parts		N/A
5.2	**Insulation and wiring**		**P**
	Voltage, current, altitude, and humidity requirements		P
	Adequate clearances and creepage distances between connectors and live parts at different voltages or between live parts and non-current-carrying accessible parts		P
	Protect from hazardous live parts, including during installation		N/A
	The mechanical integrity of internal connections		P
5.3	**Venting**		**P**
	Pressure relief function		P
	Encapsulation used to support cells within an outer casing		P
5.4	**Temperature/voltage/current management**		**P**
	The design prevents abnormal temperature-rise		P
	Voltage, current, and temperature limits of the cells		P
	Specifications and charging instructions for equipment manufacturers		P
5.5	**Terminal contacts of the battery pack and/or battery system**		**P**
	Polarity marking(s)		**P**
	Polarity marking not provided for keyed external connector		N/A
	Capability to carry the maximum anticipated current		P
	External terminal contact surfaces		P
	Terminal contacts are arranged to minimize the risk of short circuits		P
5.6	**Assembly of cells, modules, or battery packs into battery systems**		**P**
5.6.1	General		P
	Independent control and protection method(s)		P

IEC 62619			
Clause	Requirement + Test	Result - Remark	Verdict
	Recommendations of cell operating limits, mounting advice, storage conditions and other design recommendations by the cell manufacturer		P
	Batteries designed for the selective discharge of a portion of their series connected cells		N/A
	Protective circuit component(s) and consideration to the end-device application		N/A
5.6.2	Battery system design		P
	The voltage control function		P
	Maximum charging/discharging current of the cell are not exceeded		P
5.7	**Operating region of lithium cells and battery systems for safe use**		**P**
	The cell operating region.....:	Listed in the specification of cell.	P
	Designation of battery system to comply with the cell operating region		P
5.8	**System lock (or system lock function)**		**P**
	Non-resettable function to stop battery operation		P
	Manual with procedure for resetting of battery operation		N/A
	Emergency battery final discharge		N/A
5.9	**Quality plan**		**P**
	Manufacturing quality plan (for example: ISO9001, etc.) prepared and implemented.....:	ISO 9001 certificate provided.	P
	The process capabilities and the process controls		P

6	**TYPE TEST CONDITIONS**		P
6.1	**General**		**P**
6.2	**Test items**		**P**
	Cells or batteries that are not more than six months old (See Table 1 of IEC 62619)		P
	Capacity confirmation of the cells or batteries		P
	Default ambient temperature of test, 25 °C ± 5 °C		P
7	**SPECIFIC REQUIREMENTS AND TESTS**		P
7.1	**Charging procedure for test purposes**		**P**
	The battery discharged to a specified final voltage prior to charging		P

IEC 62619			
Clause	Requirement + Test	Result - Remark	Verdict
	The cells or batteries charged using the method specified by the manufacturer ..... :	50A CC charge to 57.6V, then CV charge till charge current decline to ⩽5A	P
7.2	**Reasonably foreseeable misuse**		**P**
7.2.1	External short-circuit test (cell or cell block)		N/A
	Short circuit with total resistance of 30 mΩ ± 10 mΩ at 25 °C ± 5 °C		N/A
	Results: no fire, no explosion		N/A
7.2.2	Impact test (cell or cell block)		N/A
	Cylindrical cell, longitudinal axis impact		N/A
	Prismatic cell, longitudinal axis and lateral axis impact		N/A
	Results: no fire, no explosion.		N/A
7.2.3	Drop test (cell or cell block, and battery system)		P
7.2.3.1	General		P
7.2.3.2	Whole drop test (cell or cell block, and battery system)		N/A
	Description of the Test Unit..... :		—
	Mass of the test unit (kg)..... :		—
	Height of drop (m)..... :		—
	Results: no fire, no explosion		N/A
7.2.3.3	Edge and corner drop test (cell or cell block, and battery system)		P
	Description of the Test Unit..... :	Battery	—
	Mass of the test unit (kg)..... :	SR-SE05B: 44,00kg SR-EOC05B-UL: 42.80kg SR-EOS05B-Pro: 48.40kg	—
	Height of drop (m)..... :	0,1m	—
	Results: no fire, no explosion		P
7.2.4	Thermal abuse test (cell or cell block)		N/A
	Results: no fire, no explosion		N/A
7.2.5	Overcharge test (cell or cell block)		N/A
	For those battery systems that are provided with only a single protection for the charging voltage control		—
	Results: no fire, no explosion ..... :	See Table 7.2.5.	N/A
7.2.6	Forced discharge test (cell or cell block)		N/A
	Cells connected in series in the battery system..... :		N/A

IEC 62619			
Clause	Requirement + Test	Result - Remark	Verdict
	Redundant or single protection for discharge voltage control provided in battery system ..... :		N/A
	Target Voltage..... :		N/A
	Maximum discharge current of the cell, Im..... :		N/A
	Discharge current for forced discharge, 1.0 It..... :		N/A
	Discharging time, t = (1 It / Im) x 90 (min.)..... :		N/A
	Results: no fire, no explosion ..... :	See Table 7.2.6.	N/A
7.3	**Considerations for internal short-circuit – Design evaluation**		P
7.3.1	General	Cell level according to 7.3.2 internal short-circuit test. Ref. Certif. No. JPTUV-153823	P
7.3.2	Internal short-circuit test (cell)		N/A
	Samples preparation procedure: In accordance with Clause A.5 and A.6 of IEC 62133-2:2017		N/A
	Tested per 7.3.2 b) in an ambient temperature of 25 °C ± 5 °C.		N/A
	The appearance of the short-circuit location recorded by photograph or other means..... :		—
	The pressing was stopped - When a voltage drop of 50 mV was detected; or		N/A
	- The pressing force of 800 N (cylindrical cells) or 400 N (prismatic cells) was reached		N/A
	Results: no fire ..... :	See Table 7.3.2.	N/A
7.3.3	Propagation test (battery system)	Cell level according to 7.3.2 internal short-circuit test	N/A
	Method to create a thermal runaway in one cell ... :	See Annex B	N/A
	Results: No external fire from the battery system, no battery case rupture..... :	See Table 7.3.3.	N/A

8	**BATTERY SYSTEM SAFETY (CONSIDERING FUNCTIONAL SAFETY)**		P
8.1	**General requirements**		**P**
	Functional safety analysis for critical controls	Relevant documents provided by the client which indicate analysis for function safety meet the requirement of the IEC 60730-1 Annex H.	P
	Conduct of a process hazard analysis for both the cell manufacturing process and the battery system manufacturing process		P

IEC 62619			
Clause	Requirement + Test	Result - Remark	Verdict
	Conduct of risk assessment and mitigation of the battery system		P
8.2	**Battery management system (or battery management unit)**		**P**
8.2.1	Requirements for the BMS		P
	The safety integrity level (SIL) target of the BMS		P
	The charge control evaluated by tests in clauses 8.2.2 to 8.2.4		P
8.2.2	Overcharge control of voltage (battery system)		P
	The exceeded charging voltage applied to the whole battery system		P
	The exceeded charging voltage applied to only a part of the battery system, such as the cell(s) .....:		N/A
	Results: no fire, no explosion .....:	See Table 8.2.2.	P
	The BMS terminated the charging before exceeding the upper limit charging voltage		P
8.2.3	Overcharge control of current (battery system)		P
	Results: no fire, no explosion .....:	See Table 8.2.3	P
	The BMS detected the overcharging current and controlled the charging to a level below the maximum charging current		P
8.2.4	Overheating control (battery system)		P
	The cooling system, if provided, was disconnected	No cooling system	N/A
	Elevated temperature for charging, 5 °C above maximum operating temperature.....:		P
	Results: no fire, no explosion .....:	See Table 8.2.4	P
	The BMS detected the overheat temperature and terminated charging		P
	The battery system operated as designed during test		P

9	**EMC**		P
	Battery system fulfil EMC requirements of the end-device application.....:	Client provided EMC test report	P

10	**INFORMATION FOR SAFETY**		P
	The cell manufacturer provides information about current, voltage and temperature limits of their products		P

IEC 62619			
Clause	Requirement + Test	Result - Remark	Verdict
	The battery system manufacturer provides information regarding how to mitigate hazards to equipment manufacturers or end-users.		P
11	**MARKING AND DESIGNATION (REFER TO CLAUSE 5 OF IEC 62620)**		P
	The marking items shown in Table 1 in IEC 62620 indicated on the cell, battery system or instruction manual.		P
	Cell or battery system has clear and durable markings		P
	Cell designation		N/A
	Battery designation	See marking.	P
	Battery structure formulation		P
12	**PACKAGING AND TRANSPORT**		P
	Refer to Annex D		P
ANNEX A	**OPERATING REGION OF CELLS FOR SAFE USE**		N/A
A.1	General		N/A
A.2	Charging conditions for safe use		N/A
A.3	Consideration on charging voltage		N/A
A.4	Consideration on temperature		N/A
A.5	High temperature range		N/A
A.6	Low temperature range		N/A
A.7	Discharging conditions for safe use		N/A
A.8	Example of operating region		N/A
ANNEX B	**PROCEDURE OF 7.3.3 PROPAGATION TEST BY LASER IRRADIATION**		N/A
B.1	**General**		**N/A**
B.2	**Test conditions**		**N/A**
B.2.1	Cell test (preliminary test)		N/A
	The cell fully charged according to the manufacturer recommended conditions.....:		—
	Laser irradiation point on the cell.....:		—
	Output power of laser irradiation.....:		—
	Tested in an ambient temperature of 25 °C ± 5 °C		N/A

IEC 62619			
Clause	Requirement + Test	Result - Remark	Verdict
	Repeat of cell test for 3 times		N/A
B.2.2	Battery system test (main test)		N/A
	The battery system fully charged according to the manufacturer recommended conditions.....:		—
	Target cell to be laser irradiated .....:		—
	The irradiation point on the target cell same or similar as that on the cell test		N/A
	Output power of laser irradiation.....:		—
	Tested in an ambient temperature of 25 °C ± 5 °C		N/A

ANNEX C	**PROCEDURE OF 7.3.3 PROPAGATION TEST BY METHODS OTHER THAN LASER**		N/A
C.1	General		N/A
C.2	Test conditions:		N/A
	– The battery fully charged according to the manufacturer recommended conditions.....:		—
	– Target cell forced into thermal runaway .....:		—
	– A specially prepared sample (e.g. a heater or a hole for nail penetration provided) used for ease of testing.....:		—
C.3	Method used for initiating the thermal runaway. 1) Heater (Heater, Burner, Laser, Inductive heating 2) Overcharge 3) Nail penetration of the cell 4) Combination of above methods 5) Other methods .....:		—

ANNEX D	**PACKAGING AND TRANSPORT**		P
	The materials and pack design chosen in a way as to prevent the development of unintentional electrical conduction, corrosion of the terminals and ingress of environmental contaminants		P
	Regulations concerning international transport of secondary lithium batteries		P

IEC 62619			
Clause	Requirement + Test	Result - Remark	Verdict

5.1	TABLE: Critical components information				P
Object / part No.	**Manufacturer / trademark**	**Type / model**	**Technical data**	**Standard**	**Mark(s) of conformity[1)]**
Cell	REPT BATTERO Energy Co., Ltd.	CB79	3,2V, 100Ah	IEC 62619: 2022	Ref. Certif. No. JPTUV-153823
Metal Enclosure	Shenzhen Changqin Industrial Co., Ltd	SGCC1.2	Thickness min.: 2m Dimensions: 646*396*150mm	--	Test with appliance
Power Input /Output Connector	Shenzhen Connection Electronic Co., Ltd.	DSTB38-04-TWIN	600V	EN IEC 60947-1:2021	CERTIFICATE No. B 108338 0003
Power wire (Connect B- and P-)	WONDERFUL HI-TECH CO LTD	1050	6AWG, 600V, 105°C	UL 758	UL E77981
Power wire (Connect B+ and BMS)	Dongguan Yueshun Electronic Technology Co., LTD	3135	16AWG, 600V, 200°C	UL 758	UL E526255
Internal Signal Wire	YONG HAO ELECTRICAL INDUSTRY CO LTD	1007	22AWG, 300V, 80°C	UL 758	UL E240426
Black plastic sheet	Shenzhen Bornsun New Material co.,Ltd	BN-FP	Thickness min.: 0,25mm V-0, 130°C	UL 94	UL E256822
PCB	Xinfeng Huihe Circuits Co Ltd	hh02g4	V-0, 130°C	UL 796	UL E358408
NTC	DONG GUAN SENSICOM ELECTRONICS TECHNOLOGY CO LTD	SNS103	R25 =10kΩ±1%	UL 1434	UL E318986

IEC 62619			
Clause	Requirement + Test	Result - Remark	Verdict

IC (EU1)	Nuvoton	M483KGCAE	V_{DD}-V_{SS}=3,3V, Max:3,6V, VIN=3,3V, Temperature rang: -40°C ~ 85°C	--	Test with appliance
IC (AU1)	O2Micro	OZ3717	VCC: 8 ~ 80V, Temperature rang: -40°C ~ 85°C	--	Test with appliance
MOSFET (MD1 ~ MD18, MC1 ~ MC18)	Depuw	DP023N10TGN	V_{DS}: 100V, V_{GS}: ±20V, I_D: 300A, Tstg: -55 ~+175°C	--	Test with appliance
Supplementary information: [1)] Provided evidence ensures the agreed level of compliance. See OD-CB2039.					

IEC 62619			
Clause	Requirement + Test	Result - Remark	Verdict

7.2.1	TABLE: External short-circuit test (cell or cell block)				N/A
Sample No.	**Ambient (at 25°C ± 5°C)**	**OCV at start of test (V dc)**	**Resistance of Circuit (mΩ)**	**Maximum Case Temperature Rise ΔT (°C)**	**Results**
--	--	--	--	--	--
--	--	--	--	--	--
--	--	--	--	--	--

Supplementary information:

A – No fire or Explosion
B – Fire
C – Explosion
D – The test was completed after 6 h
E – The test was completed after the cell casing cooled to 20% of the maximum temperature rise
F – Other (Please explain):___

7.2.5	TABLE: Overcharge test (cell or cell block)					N/A
Sample No.	**OCV at start of test (V dc)**	**OCV at end of test (V dc)**	**Measured Maximum Charging Current (A)**	**Measured Maximum Charging Voltage (V dc)**	**Max. Cell Case Temperature, (°C)**	**Results**
--	--	--	--	--	--	--
--	--	--	--	--	--	--
--	--	--	--	--	--	--

Supplementary information:

Results:
A – No fire or Explosion
B – Fire
C – Explosion
D – Test concluded when temperature reached a steady state condition
E – Test concluded when temperature returned to ambient
F – Other (Please explain): _____

IEC 62619			
Clause	Requirement + Test	Result - Remark	Verdict

7.2.6	TABLE: Forced discharge test (cell or cell block)				N/A
Sample No.	**OCV before applying reverse charge, (V dc)**	**Target Voltage (V dc)**	**Measured Reverse Charge Current It, (A)**	**Total Time for Reversed Charge Application (min)**	**Results**
--	--	--	--	--	--
--	--	--	--	--	--
--	--	--	--	--	--

Supplementary information:

Results:
A – No fire or Explosion
B – Fire
C – Explosion
D – Other (Please explain): ___

IEC 62619			
Clause	Requirement + Test	Result - Remark	Verdict

7.3.2	TABLE: Internal short-circuit test (cell)			N/A
Sample No.	**OCV at start of test, (V dc)**	**Particle location [1)]**	**Maximum applied pressure, (N)**	**Results**
--	--	--	--	--
--	--	--	--	--
--	--	--	--	--
--	--	--	--	--
--	--	--	--	--
--	--	--	--	--
--	--	--	--	--
--	--	--	--	--
--	--	--	--	--
--	--	--	--	--

Supplementary information:

[1)] Identify one of the following**:**

1: Nickel particle inserted between positive and negative (active material) coated area.

2: Nickel particle inserted between positive aluminium foil and negative active material coated area.

Results:

A – No fire or explosion
B – Fire
C – Explosion
D – Test concluded when 50 mV voltage drop occurred prior to reaching force limit
E – Test concluded when 800/400 N pressure was reached and 50 mV voltage drop was not achieved
F – Test was concluded when fire or explosion occurred
G – Other (Please explain): __

IEC 62619			
Clause	Requirement + Test	Result - Remark	Verdict

7.3.3	TABLE: Propagation test (battery system)				N/A
Sample No.	**OCV of Battery System Before Test, (V dc)**	**OCV of Target Cell Before Test, (V dc)**	**Maximum Cell Case Temperature, (°C)**	**Maximum DUT Enclosure Temperature, (°C)**	**Results**
--	--	--	--	--	--
--	--	--	--	--	--
--	--	--	--	--	--

Method of cell failure [1)]	**Location of target cell**	**Area for fire protection (m^2)**
--	--	--
--	--	--
--	--	--

Supplementary information:

1) Cell can be failed through laser exposure, applied heat, overcharge, nail penetration or combinations of these failures or other acceptable methods. See supporting documentation for details on cell failure method

2) If the battery system has no outer covering, the manufacturer is required to specify the area for fire protection.

Results:
A – No fire external to DUT enclosure or area for fire protection or no battery case rupture
B – Fire external to DUT enclosure or area for fire protection
C – Explosion
D – Battery case rupture
E – Other (Please explain): __

IEC 62619			
Clause	Requirement + Test	Result - Remark	Verdict

8.2.2	TABLE: Overcharge control of voltage (battery system)				P
Sample No.	**OCV at start of test for, (V dc)**	**Maximum Charging Current, (A)**	**Max. Charging Voltage, (V dc)**	**Max. Voltage of Cell/Cell Blocks, (V dc)**	**Results**
DUT1	2.842~2.883	95	57.19	3.622	A, D, F

	Charge Voltage Applied Battery System: 1)	
	Whole	**Part**
	66V	--

Supplementary information:

1) The exceeded voltage can be applied to only a part of the system such as the cell(s) in the battery system per Figure 6 of IEC 62619, if it is difficult to do it in using the whole battery system.

Results:
A – No Fire or Explosion
B – Fire
C – Explosion
D – The voltage of the measured cells or cell blocks did not exceed the upper limit charging voltage
E – The voltage of the measured cells or cell blocks did exceed the upper limit charging voltage
F – All function of battery system did operate as intended during the test.
G – All function of battery system did not operate as intended during the test.
H – Other (Please explain): ___

IEC 62619			
Clause	Requirement + Test	Result - Remark	Verdict

8.2.3	TABLE: Overcharge control of current (battery system)			P
Sample No.	**OCV at start of test, (V dc)**	**Max. Charging Current, (A)**	**Max. Charging Voltage, (V dc)**	**Results**
DUT1	47,92	114	48,67	A, D, F

Supplementary information:

Results:
A – No fire or Explosion
B – Fire
C – Explosion
D – Overcurrent sensing function of BMU did operate and then charging stopped
E – Overcurrent sensing function of BMU did not operate and then charging stopped
F – All function of battery system did operate as intended during the test.
G – All function of battery system did not operate as intended during the test.
H – Other (Please explain): ____

8.2.4	TABLE: Overheating control (battery system)			P
Model No.	**OCV at start (SOC 50%) of test, V dc**	**Maximum Charging Current, A**	**Measured Maximum Charging Voltage, V dc**	
DUT1	52,88	95	54,59	
Maximum Specified Temperature of Battery System, °C		**Maximum Measured Cell Case Temperature, °C**	**Results**	
45		55,1	A, D, F	

Supplementary information:

Results:
A – No fire or Explosion
B – Fire
C – Explosion
D – Temperature sensing function of BMU did operate and then charging stopped
E – Temperature sensing function of BMU did not operate and then charging stopped
F – All function of battery system did operate as intended during the test.
G – All function of battery system did not operate as intended during the test.
H – Other (Please explain): ____

IEC 62619			
Clause	Requirement + Test	Result - Remark	Verdict

9	**TABLE: EMC**				**N/A**
Standard used for EMC test:					
Sample No.	**EMC Test Item**	**Battery Condition**	**EMC Test Level/ Parameters**	**Compliance Criteria**	**Results**
--	--	--	--	--	--

Supplementary information:

Battery Condition During EMC test

1 – In Operation Mode, [ ] Supplied at ____, [ ] Load at___

2 – In non-operation Mode, Battery state of charge (SOC) before test at around____

Compliance Criteria and Test Results:
A – No fire or Explosion
B – Fire
C – Explosion
D – Battery system did operate as intended during the test.
E - All function of battery system did operate as intended after the test.
F - All function of battery system did not operate as intended during the test, (Please explain): ____
G - Other (Please explain): ____

Attachment 1(Pictures for product)


Overview of battery (Model: SR-SE05B)

Overview of battery (Model: SR-SE05B)


Overview of battery (Model: SR-EOC05B-UL)




Overview of battery (Model: SR-EOC05B-UL)

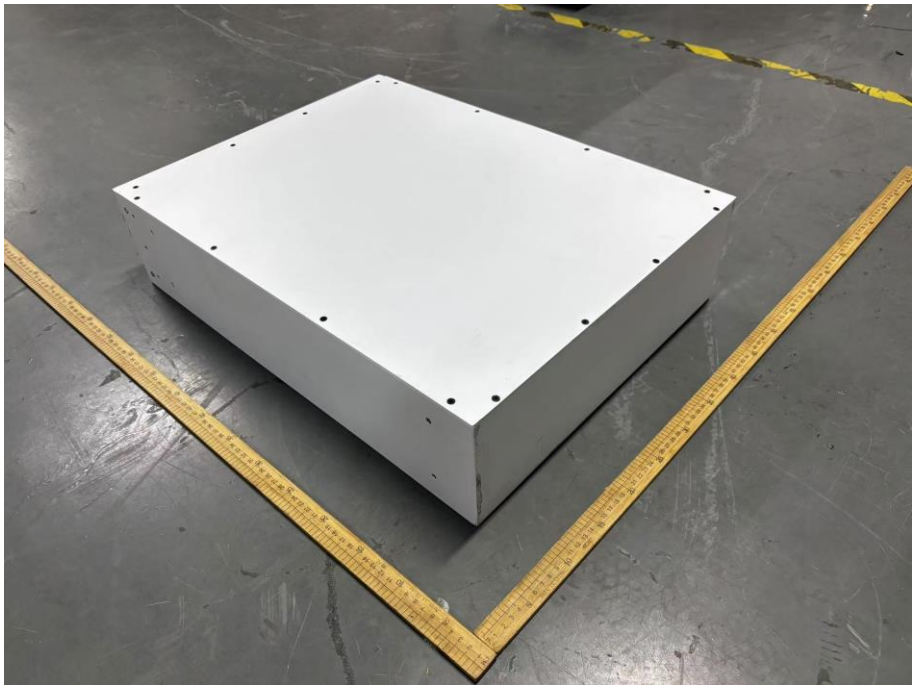


Overview of battery (Model: SR-EOS05B-Pro)




Overview of battery (Model: SR-EOS05B-Pro)

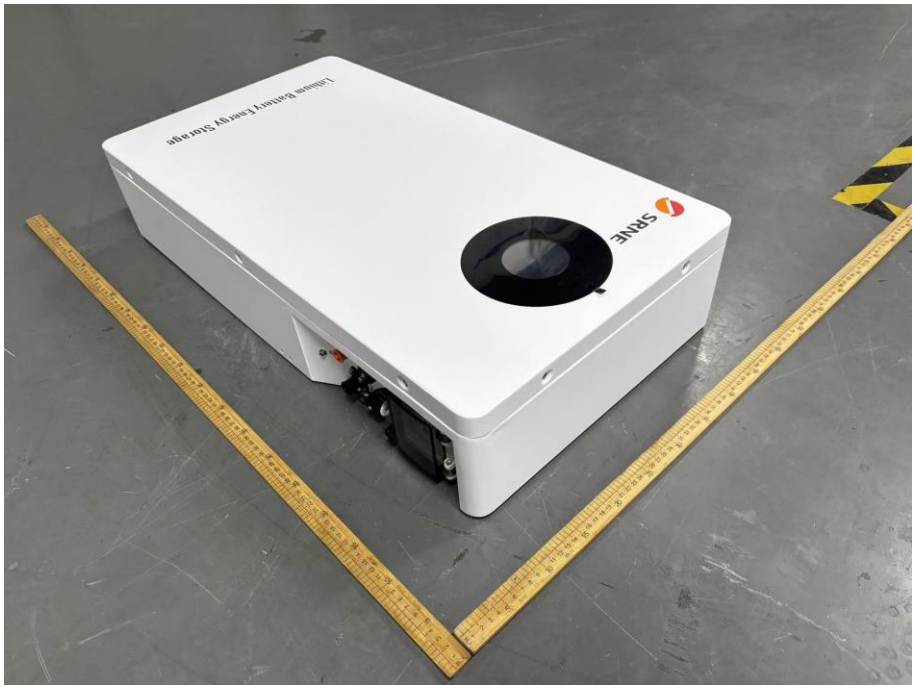


Ports view

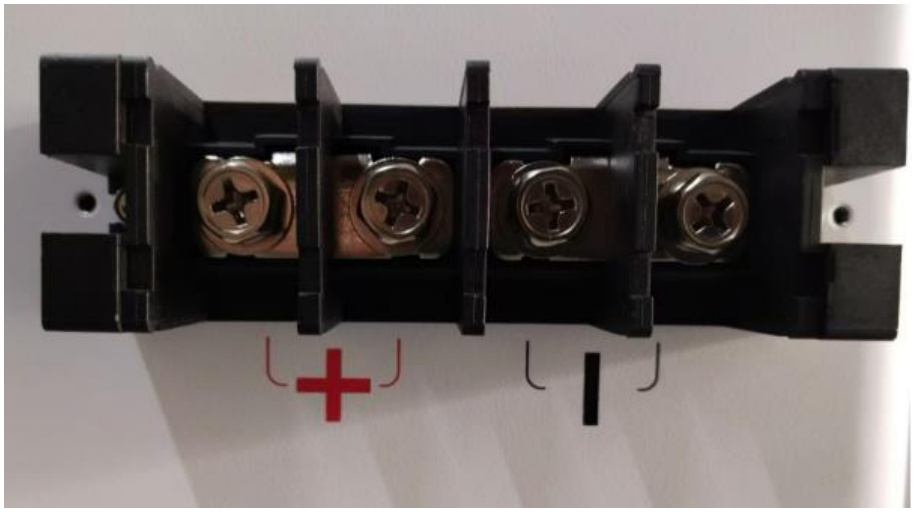


Internal view of battery

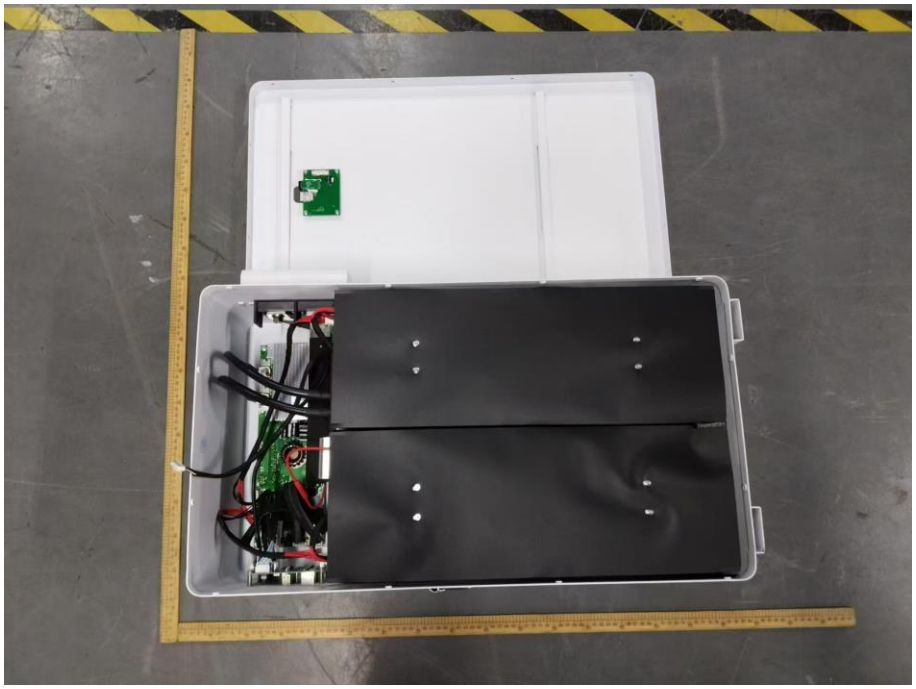

Internal view of battery

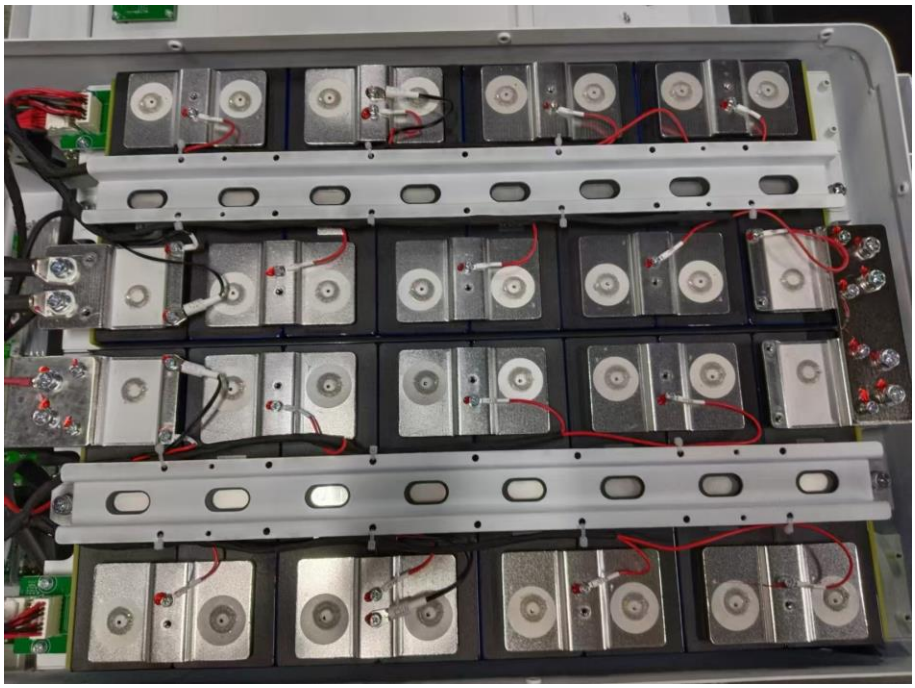

Top view of PCB

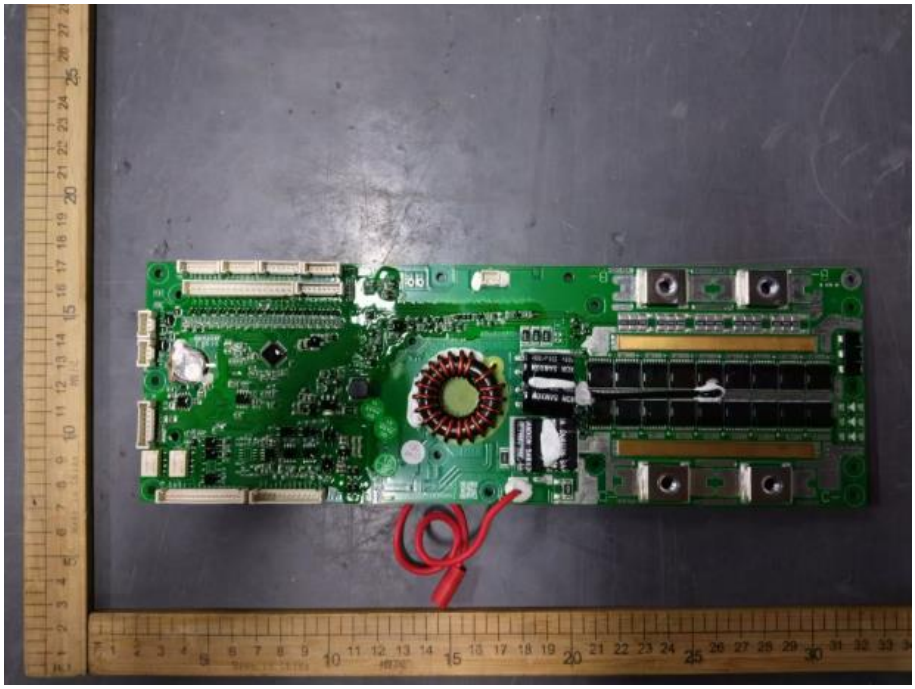

Back view of main PCB
